

BACKFILL ALL CUTOUTS AROUND PLAY STRUCTURE

SUPPORTS AND OTHER PENETRATIONS WITH
PLAYSEAL FILLER COMPOUND
NOTE: PLAYSEAL TO PENETRATE INTO OPENING
1/2" MIN. PLAYSEAL TO EXTEND ABOVE TILE
LINE BY 1/8" AND BE STRUCK OFF IN A
UNIFORM FASHION.(SEE INSTALLATION GUIDE
FOR SPECIFIC INSTRUCTIONS.)

PLAYGUARD TILE, CUT TILES ALONG PERIPHERY
AND PENETRATIONS AS REQUIRED.

ADHESIVE BETWEEN GEOTEX AND TIMBER,
APPLIED AT 45 SQ.FT./GAL.

NOTE:
TILE, GEOTEX AND TIMBER
MUST BE CLEAN AND DRY
WHEN APPLYING THE ADHESIVE.

TAMP IN BACKFILL, SLOPE TO MATCH
EXISTING GRADE, PLACE SOD OR SEED GRASS.
KEEP BACKFILL SLIGHTLY HIGHER THAN TILE
ELEVATION TO ALLOW FOR SETTLING.

6"X 8" TREATED TIMBER, (MIN.)
ANCHORED WITH 1"X 24"LG. REBAR,
(3) PIECES PER 8FT LENGTH.

TYPICAL PLAY STRUCTURE
SUPPORT

CUT PLAYGUARD AROUND PENETRATIONS
AS REQUIRED. MAX. CLEARANCE NOT TO
EXCEED 1/4".


PLAYGRIP ADHESIVE LAYER
APPLIED AT 45 SQ FT/GAL.
USE 1/8"SQ. NOTCHED TROWEL

8OZ / SQ.YD. NON-WOVEN POLYPROPYLENE
GEOTEXTILE,100% COVERAGE OVER COMPACTED
GRADE AND FOOTER.OVERLAP FIELD SEAMS A
MINIMUM OF 4".

LIMESTONE SCREENINGS OR EQUIVALENT,
MAX. AGGREGATE SIZE, 3/8"DIA., INSTALLED
4" DEEP MIN., COMPACTED TO 95%
STANDARD PROCTOR.


COMPACTED EARTH
SUB BASE

CONCRETE FOOTER FOR
STRUCTURE SUPPORT POST

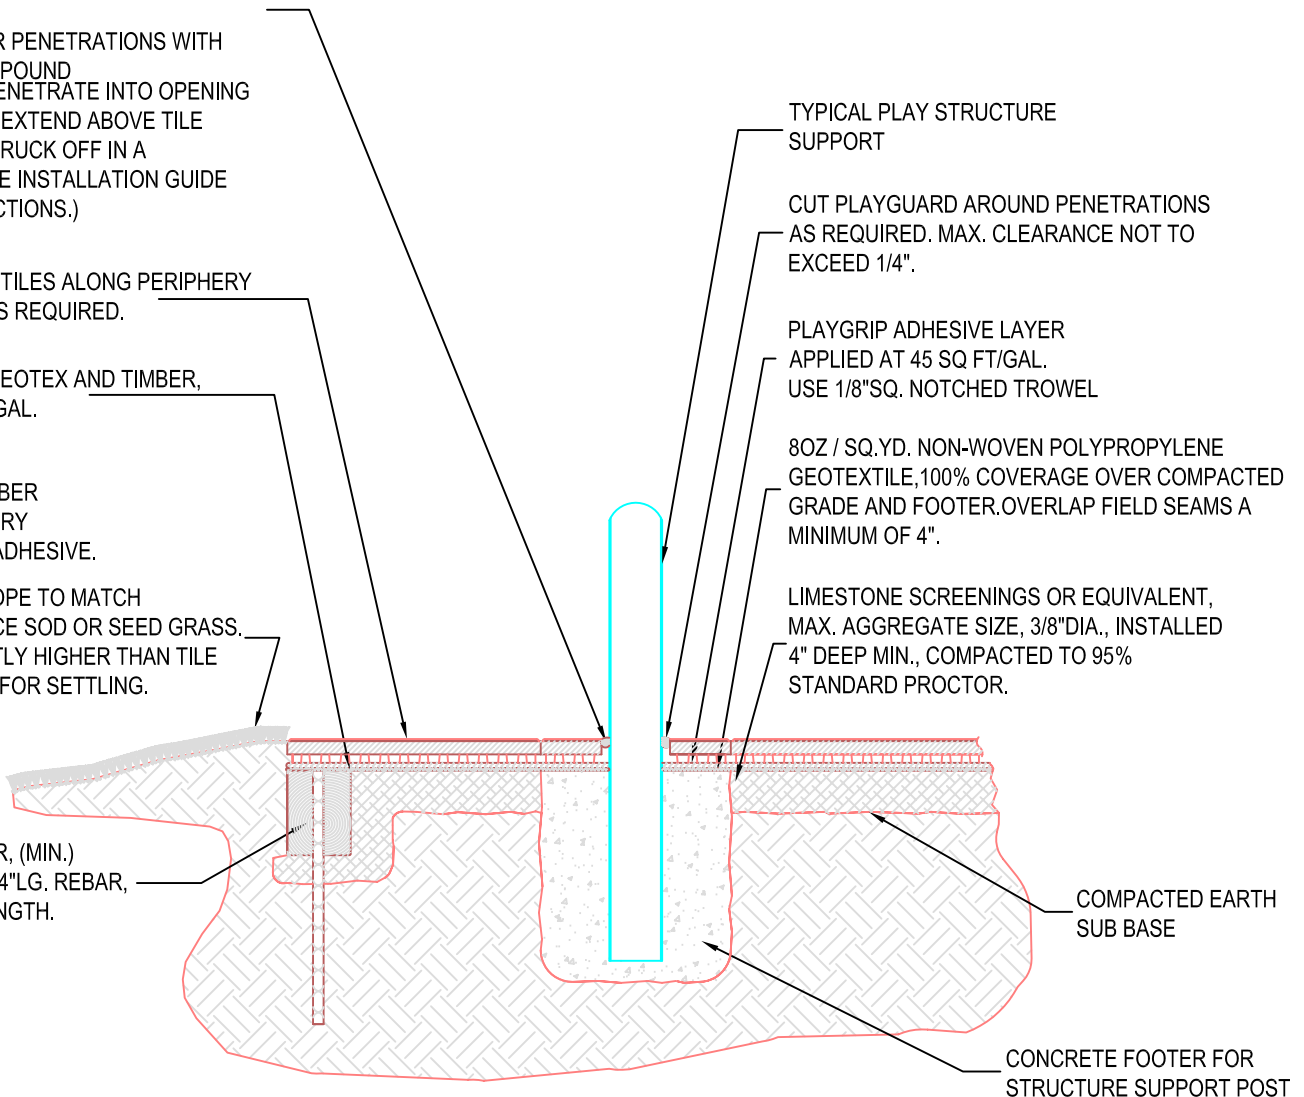

NOTES:

1. INSTALLATION TO BE COMPLETED IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS.
2. DO NOT SCALE DRAWINGS.
3. COLOUR TO BE CONFIRMED WITH OWNER PRIOR TO INSTALLATION.



BELOW GRADE, TIMBER FOOTER W/LOOSE BACKFILL

PLAYGUARD